

Jericho Wind, Inc.

Final Wind Turbine Specification Report – Jericho Wind Energy Centre

Prepared by:

AECOM

300 – 300 Town Centre Boulevard 905 477 8400 tel
Markham, ON, Canada L3R 5Z6 905 477 1456 fax
www.aecom.com

Project Number:

60155032

Date:

February, 2013

Table of Contents

Statement of Qualifications and Limitations

Letter of Transmittal

Distribution List

Executive Summary

	page
1. Introduction	3
1.1 Summary of Wind Turbine Specification Report Requirements	3
1.2 The Proponent	3
1.3 Project Study Area	4
2. Technical Specifications	6
3. Acoustic Emissions Data	6

List of Figures

Figure 1-1 Project Study Area	5
-------------------------------------	---

List of Tables

Table 1-1 Adherence to Wind Turbine Specification Report Requirements	3
Table 2-1 Summary of Technical Specifications	6

Appendices

Appendix A. Manufacturer Technical Data

Glossary of Terms

GE	General Electric	O. Reg. 359/09.....	Ontario Regulation 359/09
MOE	Ontario Ministry of the Environment	The Project.....	Jericho Wind Energy Centre
MW	Megawatt	REA.....	Renewable Energy Approval
NextEra.....	NextEra Energy Canada, ULC	TC	Transport Canada

1. Introduction

Jericho Wind, Inc., a wholly owned subsidiary of NextEra Energy Canada, ULC, (NextEra) is proposing to construct a wind energy project in the Municipality of Lambton Shores and the Township of Warwick, in Lambton County, Ontario and in the Municipality of North Middlesex, in Middlesex County, Ontario. The Project is referred to as the Jericho Wind Energy Centre (the “Project”). All turbines will be located on private lands.

This Wind Turbine Specification Report was prepared in accordance with the requirements of the REA process outlined in *Ontario Regulation 359/09 (O. Reg. 359/09)* and the Technical Guide to Renewable Energy Approvals (Ontario Ministry of the Environment (MOE), 2011).

The following sections outline the specifications of the turbine technology selected for this Project.

1.1 Summary of Wind Turbine Specification Report Requirements

The requirements for the Wind Turbine Specification Report defined under *O.Reg. 359/09* are provided in the following table (Table 1-1).

Table 1-1 Adherence to Wind Turbine Specification Report Requirements

Requirement	Completed	Corresponding Section
The make, model, name plate capacity, hub height above grade and rotational speeds.	Yes	2.0 (Table 2-1)
The acoustic emissions data, determined and reported in accordance with standard CAN/CSA-C61400-11-07, “Wind Turbine Generator Systems – Part II: Acoustic Noise Measurement Techniques”, dated October 2007, including the overall sound power level, measurement uncertainty value, octave-band sound power levels (linear weighted) and tonality and tonal audibility.	Yes	3.0 (Appendix A)

1.2 The Proponent

The Project will be owned and operated by Jericho Wind, Inc., a subsidiary of NextEra. NextEra Energy Canada’s indirect parent company is NextEra Energy Resources, LLC, a global leader in wind energy generation with a current operating portfolio of over 100 wind energy projects in North America. Wind farms currently owned and operated by NextEra Energy Canada include: Mount Copper and Mount Miller (both 54 megawatt (MW)), located in Murdochville, Quebec; Pubnico Point, (31 MW) located near Yarmouth, Nova Scotia; Ghost Pine (82 MW), located in Kneehill County, Alberta; and Conestogo (23 MW) located in Wellington County, Ontario.


The primary contacts for the Project are as follows:

Project Proponent	Project Consultant
Ross D. Groffman Project Director NextEra Energy Canada, ULC 390 Bay Street, Suite 1720 Toronto, Ontario, M5H 2Y2 <i>Phone:</i>416.364.9714 <i>Email:</i>Jericho.Wind@NextEraEnergy.com <i>Website:</i> ..www.NextEraEnergyCanada.com	Marc Rose Senior Environmental Planner AECOM 300-300 Town Centre Blvd. Markham, Ontario, L3R 5Z6 <i>Phone:</i> 905.477.8400 x388 <i>Email:</i> marc.rose@aecom.com

1.3 Project Study Area

The proposed Project is located in the Municipality of Lambton Shores and the Township of Warwick, in Lambton County, Ontario and in the Municipality of North Middlesex, in Middlesex County, Ontario (Figure 1-1). The Project Study Area consists of the areas being studied for the wind energy component (Wind Energy Centre Study Area), as well as for the interconnection route (i.e., the area being studied for transmission lines to connect the Project to the electrical grid) (Transmission Line Study Area). The Wind Energy Centre Study Area is generally bounded by Lakeshore Road/Bog Line to the north, Egremont Road to the south, the Lambton Shores/North Middlesex municipal boundary to the east and Rawlings Road/Elarton Road to the west, in Lambton County. The Transmission Line Study Area is generally bounded by Kennedy Line, Parkhill Drive and Elginfield Road to the north, Jura Line, Elm Tree Drive and Poplar Hill Road to the south, Fernhill Drive to the east, and the Jericho Road to the west, in Lambton and Middlesex Counties.

The location of the Project Study Area was defined early in the planning process for the proposed wind energy facility, based on the availability of wind resources, approximate area required for the proposed project, and availability of existing infrastructure for connection to the electrical grid. The Project Study Area was used to facilitate information collection.

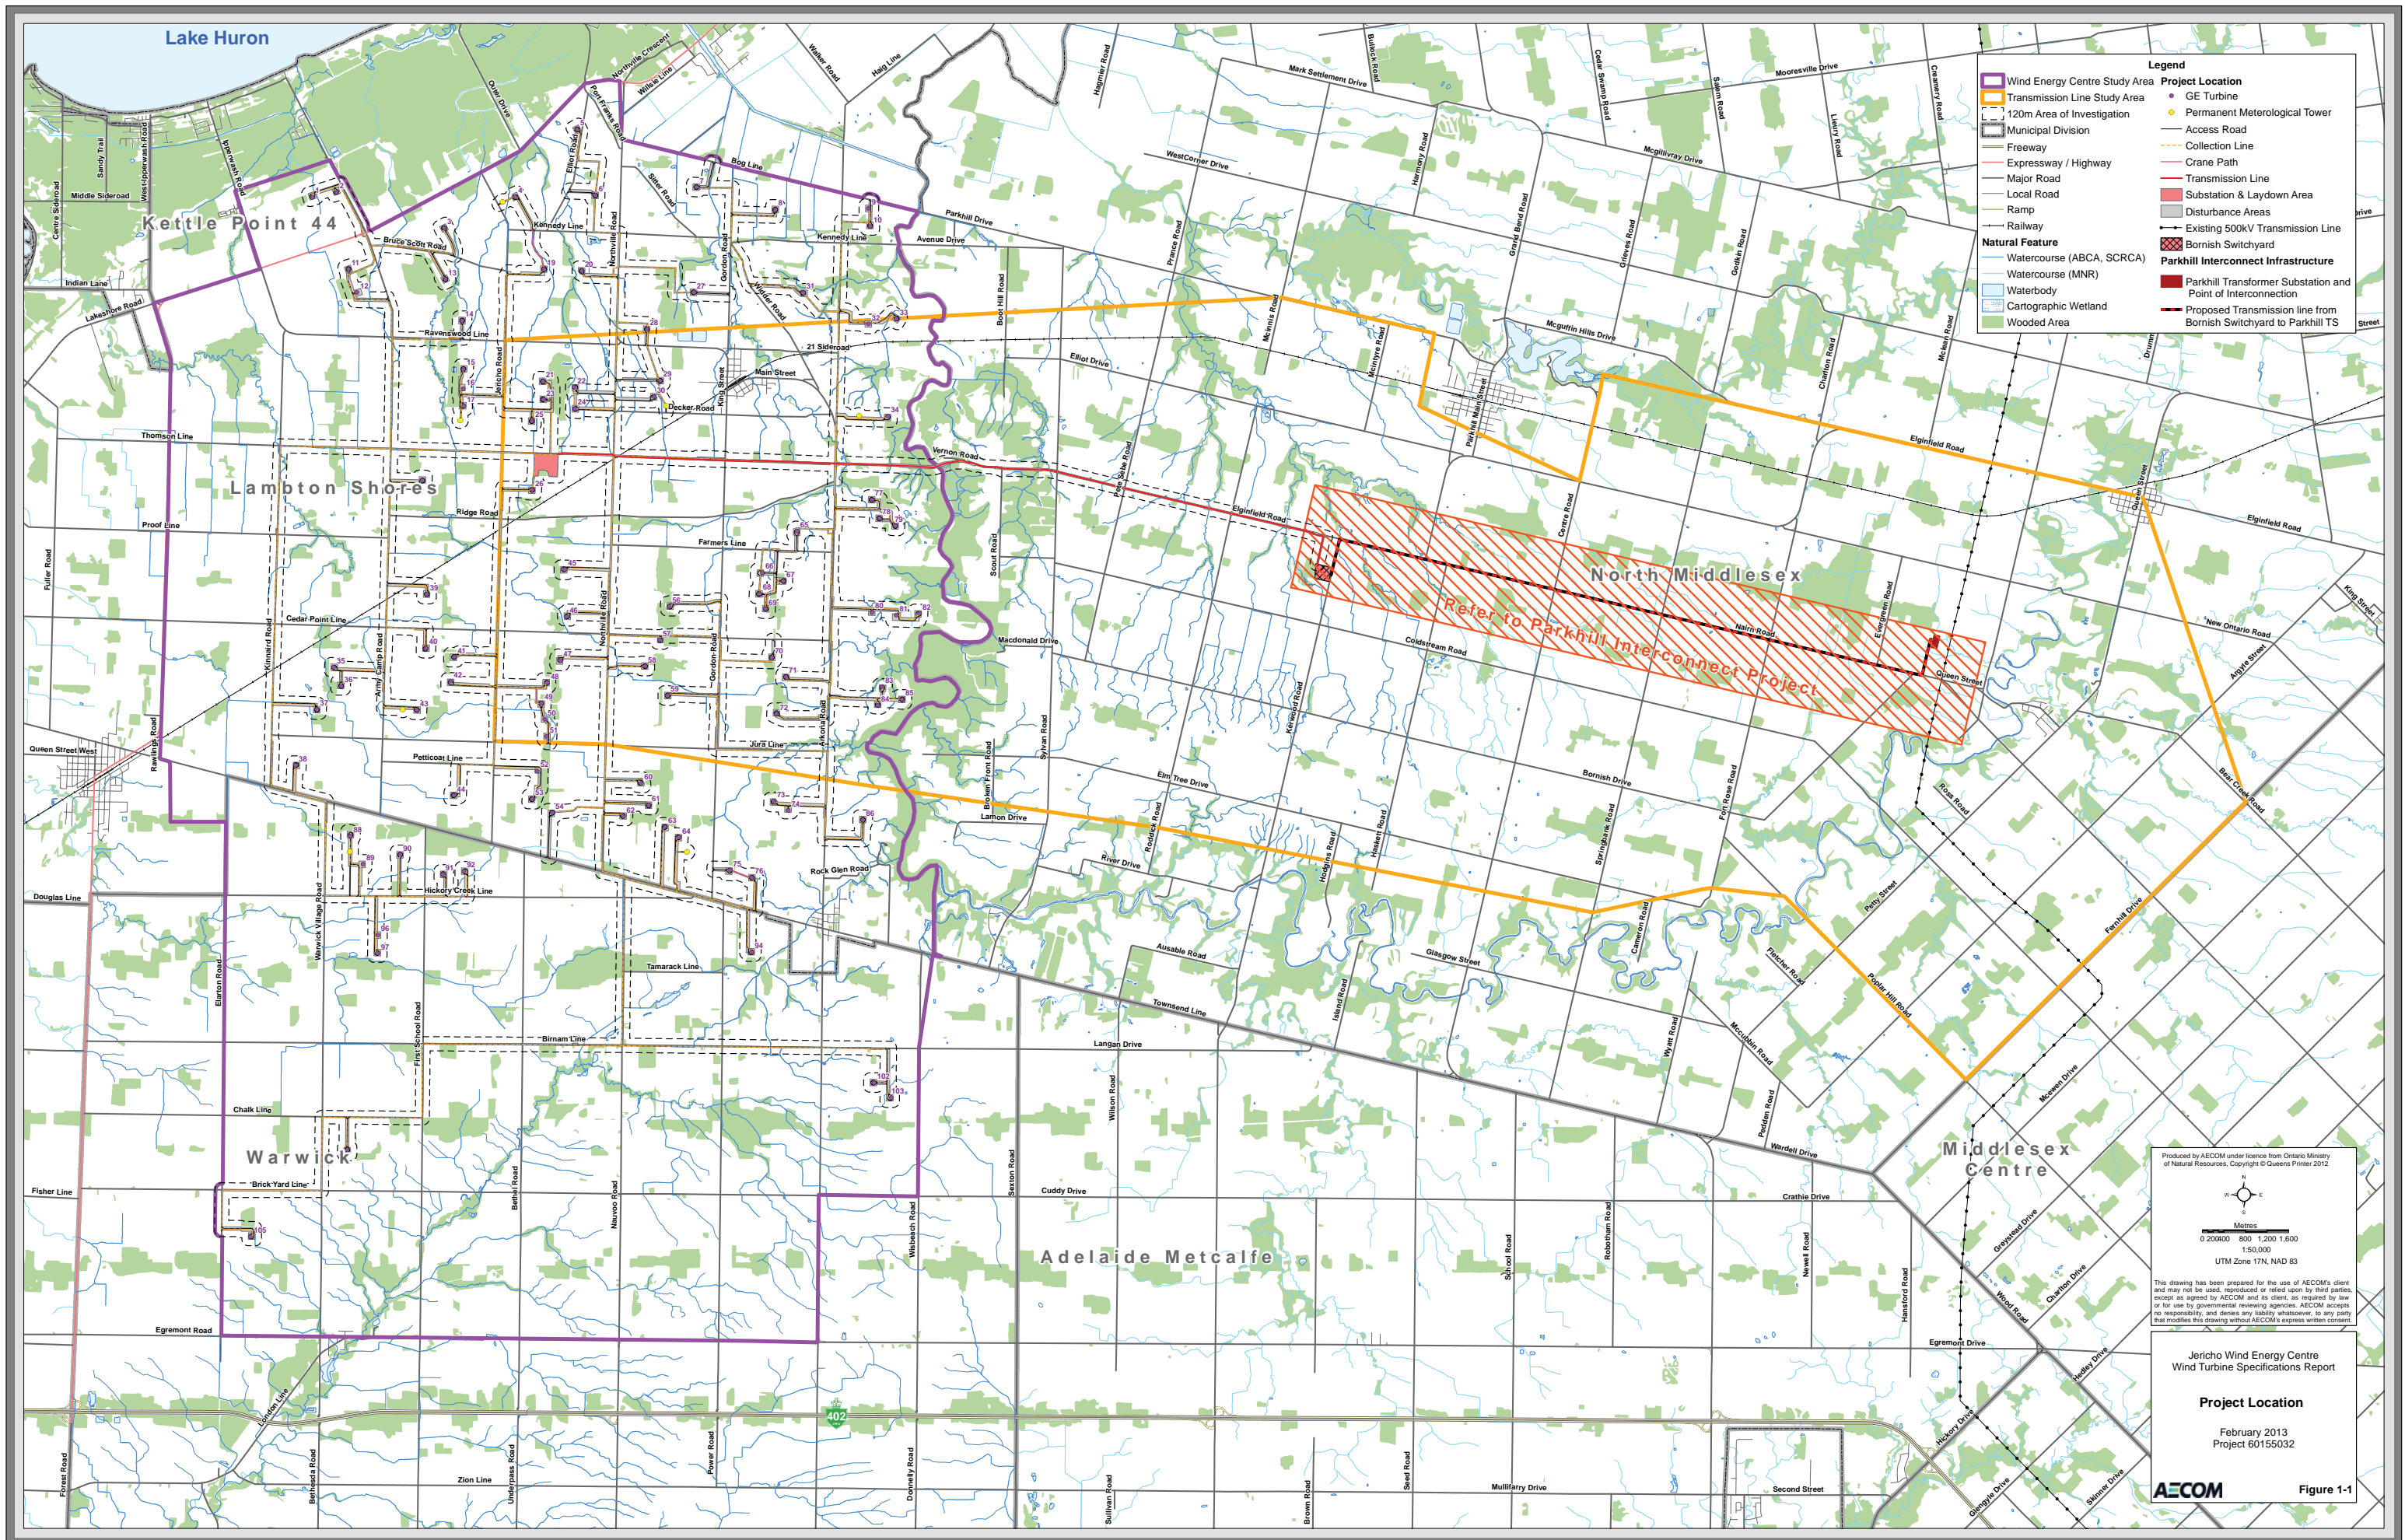

Produced by AECOM under license from Ontario Ministry of Natural Resources. Copyright © Queens Printer 2012

Metres
 0 20000 800 1,200 1,600
 1:50,000
 UTM Zone 17N, NAD 83

This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or relied upon by third parties, except as agreed by AECOM and its client, as required by law or for use by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without AECOM's express written consent.

Jericho Wind Energy Centre
 Wind Turbine Specifications Report

Project Location
 February 2013
 Project 60155032

AECOM Figure 1-1

2. Technical Specifications

With a total nameplate capacity of up to 150 MW, the Project is categorized as a Class 4 wind facility under O. Reg. 359/09. Although Jericho Wind, Inc. is seeking an REA for up to 97 turbine locations, approximately 92 turbines are proposed to be constructed for the Project.

The wind turbine technology proposed for this Project is the GE 1.6-100 Wind Turbine. The turbines are 3-bladed, upwind, horizontal-axis wind turbines that are state of the art technology. The turbines have a 100 m rotor diameter with a swept area of 7,854 m²; each blade is connected to the main shaft via the hub. The turbine is mounted on an 80 m tubular steel tower which contains an internal ladder provided for maintenance access. The turbine will be constructed on a foundation that is approximately 400 m². The foundation consists of poured concrete and steel rebar to provide added strength.

The nacelle houses the main components of the wind turbine such as the rotor shaft, gear box, couplings, control panel, bearing brackets and the generator. The nacelle is equipped with sound-proofing, is ventilated and the interior is illuminated with electric lights. Some of the wind turbines will have external lighting in accordance with the requirements of Transport Canada (TC).

The following table provides a description of the GE 1.6-100 Wind Turbine that will be used for the Project. Additional turbine specifications and acoustic emissions data are provided in **Appendix A** as supplied by General Electric.

Table 2-1 Summary of Technical Specifications

Specification	GE 1.6-100 Wind Turbine
Make	General Electric
Model	1.6-100
Name Plate Capacity	1.62 MW
Hub Height	80 m
Rotor Diameter	100 m
Minimum Rotational Speed	9.75 rpm
Maximum Rotational Speed	15.33 rpm

3. Acoustic Emissions Data

Please refer to **Appendix A** *Manufacturer Technical Data* for the sound power ratings for the GE 1.6-100 Wind Turbine in addition to the octave band spectra.

Appendix A

Manufacturer Technical Data

Technical Description of the 1.6-100 Wind Turbine with Low-Noise Trailing Edges (LNTE's) and Major Components

The wind turbine is a three bladed, upwind, horizontal-axis wind turbine with a rotor diameter of 100 m. The turbine rotor and nacelle are mounted on top of a tubular tower giving a rotor hub height of 80m. The machine employs active yaw control (designed to steer the machine with respect to the wind direction), active blade pitch control (designed to regulate turbine rotor speed), and a generator/power electronic converter system.

The wind turbine features a distributed drive train design wherein the major drive train components including main shaft bearings, gearbox, generator, yaw drives, and control panel are attached to a bedplate (see Figure 1).

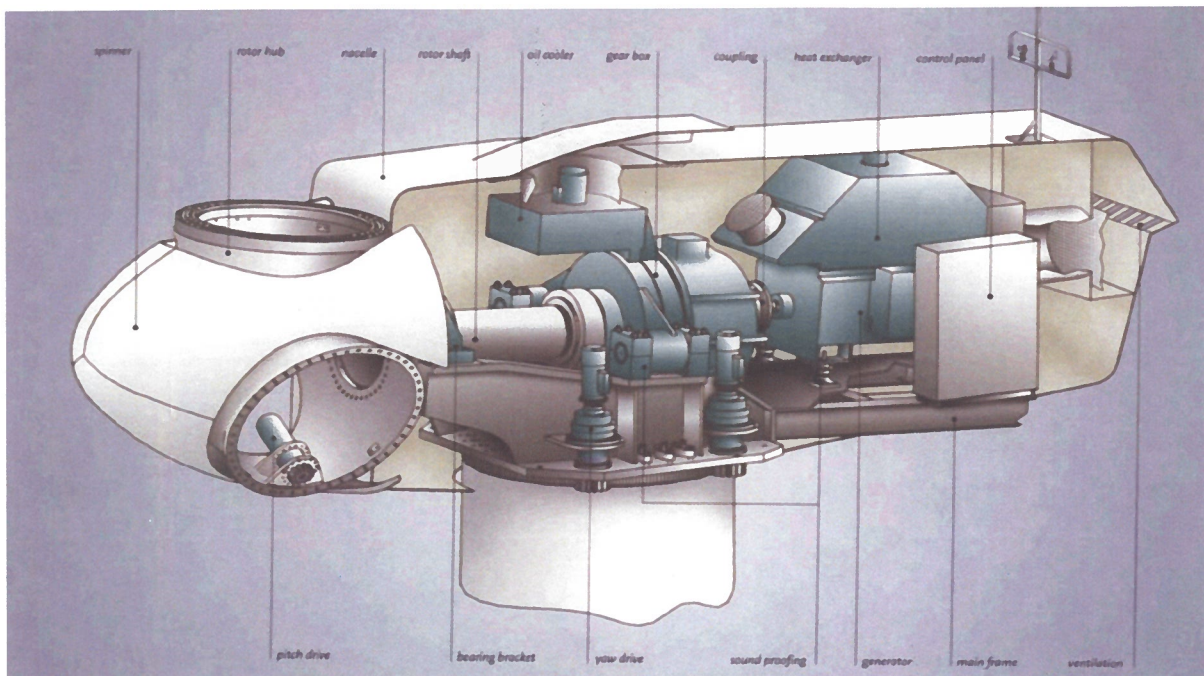


Figure 1: GE Energy 1.6-100 wind turbine nacelle layout

Rotor

The rotor diameter is 100 m, resulting in a swept area of 7,854 m, and is designed to operate between 9.75 and 15.33 revolutions per minute (rpm). Rotor speed is regulated by a combination of blade pitch angle adjustment and generator/converter torque control. The rotor spins in a clock-wise direction under normal operating conditions when viewed from an upwind location.

Full blade pitch angle range is approximately 90°, with the 0°-position being with the airfoil chord line flat to the prevailing wind. The blades being pitched to a full feather pitch angle of approximately 90° accomplishes aerodynamic braking of the rotor; whereby the blades "spill" the wind thus limiting rotor speed.

Blades

There are three rotor blades used on each wind turbine. The airfoils transition along the blade span with the thicker airfoils being located in-board towards the blade root (hub) and gradually tapering to thinner cross sections out towards the blade tip.

Blade Pitch Control System

The rotor utilizes three (one for each blade) independent electric pitch motors and controllers to provide adjustment of the blade pitch angle during operation. Blade pitch angle is adjusted by an electric drive that is mounted inside the rotor hub and is coupled to a ring gear mounted to the inner race of the blade pitch bearing (see Figure 1).

GE's active-pitch controller enables the wind turbine rotor to regulate speed, when above rated wind speed, by allowing the blade to "spill" excess aerodynamic lift. Energy from wind gusts below rated wind speed is captured by allowing the rotor to speed up, transforming this gust energy into kinetic which may then be extracted from the rotor.

Three independent back-up units are provided to power each individual blade pitch system to feather the blades and shut down the machine in the event of a grid line outage or other fault. By having all three blades outfitted with independent pitch systems, redundancy of individual blade aerodynamic braking capability is provided.

Hub

The hub is used to connect the three rotor blades to the turbine main shaft. The hub also houses the three electric blade pitch systems and is mounted directly to the main shaft. Access to the inside of the hub is provided through a hatch.

Gearbox

The gearbox in the wind turbine is designed to transmit power between the low-rpm turbine rotor and high-rpm electric generator. The gearbox is a multi-stage planetary/helical gear design. The gearbox is mounted to the machine bedplate. The gearing is designed to transfer torsional power from the wind turbine rotor to the electric generator. A parking brake is mounted on the high-speed shaft of the gearbox.

Bearings

The blade pitch bearing is designed to allow the blade to pitch about a span-wise pitch axis. The inner race of the blade pitch bearing is outfitted with a blade drive gear that enables the blade to be driven in pitch by an electric gear-driven motor/controller.

The main shaft bearing is a roller bearing mounted in a pillow-block housing arrangement. The bearings used inside the gearbox are of the cylindrical, spherical and tapered roller type. These bearings are designed to provide bearing and alignment of the internal gearing shafts and accommodate radial and axial loads.

Brake System

The electrically actuated individual blade pitch systems act as the main braking system for the wind turbine. Braking under normal operating conditions is accomplished by feathering the blades out of the wind. Any single feathered rotor blade is designed to slow the rotor, and each rotor blade has its own back-up to provide power to the electric drive in the event of a grid line loss.

The turbine is also equipped with a mechanical brake located at the output (high-speed) shaft of the gearbox. This brake is only applied as an auxiliary brake to the main aerodynamic brake and to prevent rotation of the machinery as required by certain service activities.

Generator

The generator is a doubly-fed induction type. The generator meets protection class requirements of the International Standard IP 54 (totally enclosed). The generator is mounted to the bedplate and the mounting is designed so as to reduce vibration and noise transfer to the bedplate.

Flexible Coupling

Designed to protect the drive train from excessive torque loads, a flexible coupling is provided between the generator and gearbox output shaft this is equipped with a torque-limiting device sized to keep the maximum allowable torque below the maximum design limit of the drive train.

Yaw System

A roller bearing attached between the nacelle and tower facilitates yaw motion. Planetary yaw drives (with brakes that engage when the drive is disabled) mesh with the outside gear of the yaw bearing and steer the machine to track the wind in yaw. The automatic yaw brakes engage in order to prevent the yaw drives from seeing peak loads from any turbulent wind.

The controller activates the yaw drives to align the nacelle to the average wind direction based on the wind vane sensor mounted on top of the nacelle.

A cable twist sensor provides a record of nacelle yaw position and cable twisting. After the sensor detects excessive rotation in one direction, the controller automatically brings the rotor to a complete stop, untwists the cable by counter yawing of the nacelle, and restarts the wind turbine.

Tower

The wind turbine is mounted on top of a tubular tower. The tubular tower is manufactured in sections from steel plate. Access to the turbine is through a lockable steel door at the base of the tower. Service platforms are provided. Access to the nacelle is provided by a ladder and a fall arresting safety system is included. Interior lights are installed at critical points from the base of the tower to the tower top.

Nacelle

The nacelle houses the main components of the wind turbine generator. Access from the tower into the nacelle is through the bottom of the nacelle. The nacelle is ventilated. It is illuminated with electric light. A hatch at the front end of the nacelle provides access to the blades and hub. The rotor can be secured in place with a rotor lock.

Anemometer, Wind Vane and Lightning Rod

An anemometer, wind vane and lightning rod are mounted on top of the nacelle housing. Access to these sensors is accomplished through a hatch in the nacelle roof.

Lightning Protection

The rotor blades are equipped with lightning receptors mounted in the blade. The turbine is grounded and shielded to protect against lightning, however, lightning is an unpredictable force of nature, and it is possible that a lightning strike could damage various components notwithstanding the lightning protection deployed in the machine.

Wind Turbine Control System

The wind turbine machine can be controlled automatically or manually from either an interface located inside the nacelle or from a control box at the bottom of the tower. Control signals can also be sent from a remote computer via a Supervisory Control and Data Acquisition System (SCADA), with local lockout capability provided at the turbine controller.

Service switches at the tower top prevent service personnel at the bottom of the tower from operating certain systems of the turbine while service personnel are in the nacelle. To override any machine operation, Emergency-stop buttons located in the tower base and in the nacelle can be activated to stop the turbine in the event of an emergency.

Power Converter

The wind turbine uses a power converter system that consists of a converter on the rotor side, a DC intermediate circuit, and a power inverter on the grid side.

The converter system consists of a power module and the associated electrical equipment. Variable output frequency of the converter allows operation of the generator.

Technical Data for the 1.6-100 with LNTE

Rotor

Diameter	100 m
Number of blades	3
Swept area	7,854 m ²
Rotor speed range	9.75 to 15.33 rpm
Rotational direction	Clockwise looking downwind
Maximum tip speed	80.3 m/s
Orientation	Upwind
Speed regulation	Pitch control
Aerodynamic brakes	Full feathering

Pitch System

Principle	Independent blade pitch control
Actuation	Individual electric drive

Yaw System

Yaw rate	0.5 degree/s
----------	--------------

1.6-100 with LNTE Calculated 1/3rd Octave Band Apparent Sound Power Level LWA,k

Table 1 provides reference values per IEC 61400-11, based on the total apparent sound power level (A-weighted) defined in the general product acoustic specification for this turbine type. The uncertainties for octave sound power levels are generally higher than for total sound power levels. Guidance is given in IEC 61400-11, Annex D. The third octave-band spectra are for information only.

1.6-100 LNTE with 80 m HH - Normal Operation 1/3 rd Octave Band Spectra									
Standard WS at 10m [m/s]	5.0	5.5	6.0	6.5	7.0	8.0	9.0	10-Cutout	
Hub Height WS at 80 m [m/s]	7.0	7.7	8.4	9.1	9.7	11.1	12.5	14-Cutout	
Frequency [Hz]	25	61.8	63.9	65.7	67.5	69.2	69.8	69.9	69.8
	32	66.2	68.3	70.1	71.9	73.7	74.2	74.3	74.2
	40	70.2	72.3	74.2	75.9	77.7	78.2	78.3	78.2
	50	73.4	75.5	77.4	79.2	80.9	81.4	81.5	81.4
	63	76.3	78.4	80.4	82.2	84.0	84.4	84.5	84.4
	80	78.6	80.8	82.8	84.7	86.6	87.0	87.0	86.9
	100	80.5	82.7	84.7	86.6	88.4	88.8	88.8	88.7
	125	81.7	83.9	85.9	87.6	89.2	89.6	89.7	89.6
	160	82.8	85.1	87.2	88.4	89.7	90.2	90.3	90.2
	200	84.0	86.3	88.5	89.2	90.1	90.4	90.5	90.5
	250	85.0	87.4	89.7	89.9	90.3	90.4	90.5	90.5
	315	85.6	88.2	90.5	90.5	90.4	90.2	90.3	90.4
	400	85.4	88.1	90.6	90.7	90.8	90.4	90.5	90.7
	500	85.1	87.8	90.5	91.2	91.6	91.3	91.4	91.7
	630	84.0	86.7	89.4	90.9	92.2	92.0	92.1	92.5
	800	82.3	84.8	87.3	89.7	91.9	92.0	92.1	92.5
	1000	81.7	83.8	85.9	88.8	91.6	92.1	92.2	92.5
	1250	82.4	84.3	86.1	88.7	91.4	92.2	92.4	92.4
	1600	82.8	84.8	86.5	88.5	90.7	91.4	91.4	90.9
	2000	83.3	85.4	87.3	88.8	90.3	90.4	90.0	89.4
2500	83.4	85.6	87.6	88.7	89.7	89.1	88.5	87.9	
3150	81.8	84.2	86.4	86.8	87.3	86.7	86.2	85.3	
4000	77.7	80.6	83.0	82.8	82.9	83.0	82.0	81.4	
5000	72.0	75.1	77.5	77.0	77.3	77.6	76.2	76.0	
6300	63.3	66.5	69.5	69.0	69.4	69.7	68.5	68.4	
8000	51.0	53.9	56.9	57.1	57.9	58.3	57.3	57.0	
10000	36.5	39.1	42.0	42.7	43.9	43.9	43.8	44.1	
12500	18.9	21.5	24.1	25.3	26.5	26.0	26.9	28.8	
16000	-6.1	-3.3	-0.8	0.3	1.2	1.2	3.4	6.4	
20000	-34.1	-30.5	-27.4	-26.9	-26.6	-25.2	-22.4	-18.9	
Total apparent sound power level L_{WA,k} [dB]	95.8	98.2	100.5	101.6	102.8	103.0	103.0	103.0	

Table 1: Calculated Apparent Third Octave Band Sound Power Level (A-weighted), 1.6-100 LNTE with 80 m hub height as function of Wind Speed v_{10m}

Tonal Audibility

At the reference measuring point R_o , a ground distance from the turbine tower vertical centerline equal to hub height plus half the rotor diameter (reference IEC 61400-11), the 1.6-100 turbine has an expected value for tonal audibility of $\Delta L_{\alpha,k} < 2$ dB, irrespective of wind speed, hub height, and grid frequency.

Uncertainty Levels

The apparent sound power levels given above are calculated mean levels. If a wind turbine noise performance test is carried out, it needs to be done in accordance with the regulations of the international standard IEC 61400-11, ed. 2.1: 2006. Uncertainty levels associated with measurements are described in IEC/TS 61400-14.

Per IEC/TS 61400-14, L_{WAd} is the maximum apparent sound power level resulting from n measurements performed according to IEC 61400-11 standard for 95 % confidence level: $L_{WAd} = \overline{L_{WA}} + K$, where $\overline{L_{WA}}$ is the mean apparent sound power level from n IEC 61400-11 testing reports and $K = 1.645 \cdot \sigma_T$.

The testing standard deviation values σ_T , σ_R and σ_P for measured apparent sound power level are described by IEC/TS 61400-14 where σ_T is the total standard deviation, σ_P is the standard deviation for product variation and σ_R is the standard deviation for test reproducibility.

Assuming $\sigma_R < 0.8$ dB and $\sigma_P < 0.8$ dB typical values, leads to calculated $K < 2$ dB for 95 % confidence level.

IEC 61400-11 and IEC/TS 61400-14 Terminology

- $L_{WA,k}$ is wind turbine apparent sound power level (referenced to 1^{-12} W) measured with A-weighting as function of reference wind speed v_{10m} . Derived from multiple measurement reports per IEC 61400-11, it is considered as a mean value.
- σ_P is the product variation i.e. the 1.6-100 with LNTE unit-to-unit product variation; typically < 0.8 dB
- σ_R is the overall measurement testing reproducibility as defined per IEC 61400-11; typically < 0.8 dB with adequate measurement conditions and sufficient amount of data samples
- σ_T is the total standard deviation combining both σ_P and σ_R
- $K = 1.645 \cdot \sigma_T$ is defined by IEC/TS 61400-14 for 95 % confidence level
- R_o is the ground measuring distance from the wind turbine tower vertical axis per IEC 61400-11
- $\Delta L_{\alpha,k}$ is the tonal audibility according to IEC 61400-11, described as potentially audible narrow band sound